
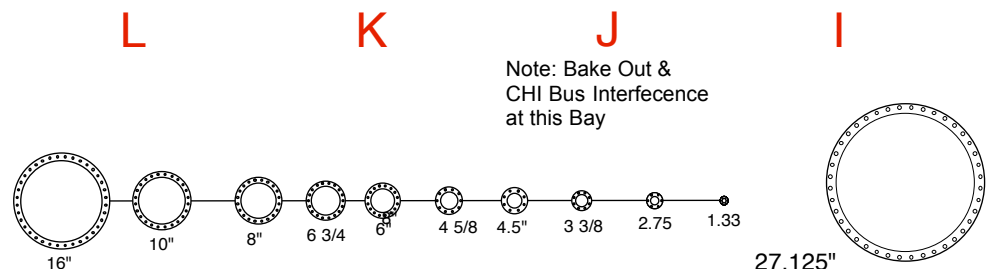


Port assignment for 2016 Operations

Gas Injectors and Ion Gauges on Separate Port Drawing

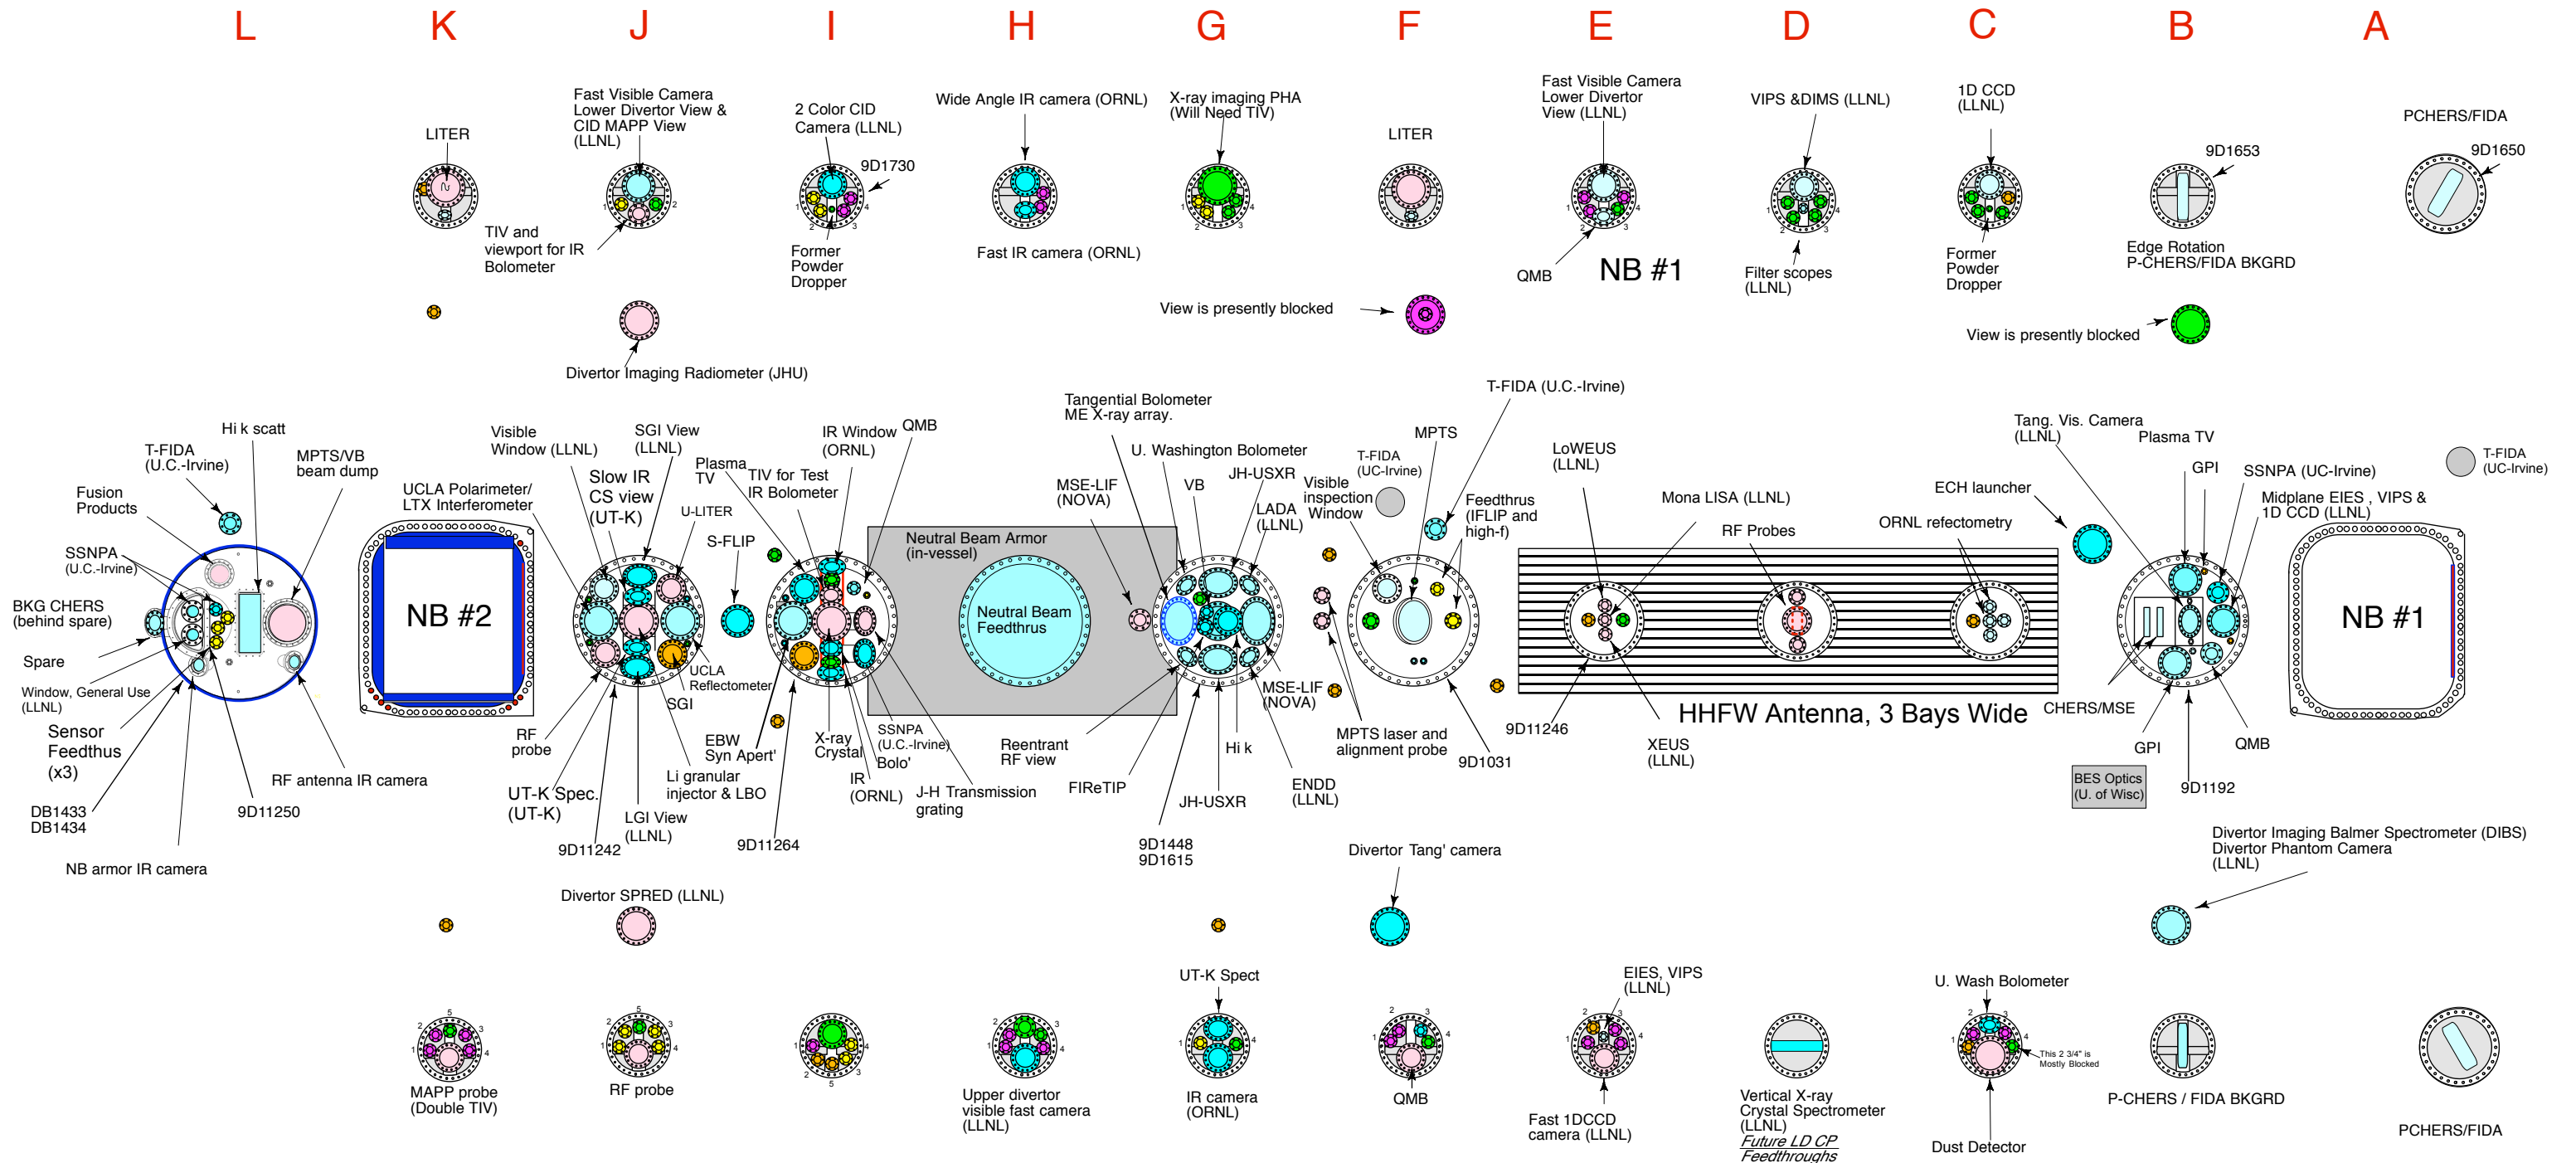

Legend for port assignments:

- Electrical Feedthrough Per 9D1095
- Other Electrical Feedthrough
- Assigned
- GIS or Gauges (Often with TIVs)
- Nominally Unassigned or Blank
- TIV for Diagnostic
- Custom Penetration

Midplane Elevation: 113'
 Platform Elevation: 109'

S.P. Gerhardt 3-16-2016